


TYPICAL WIRE CONNECTIONS

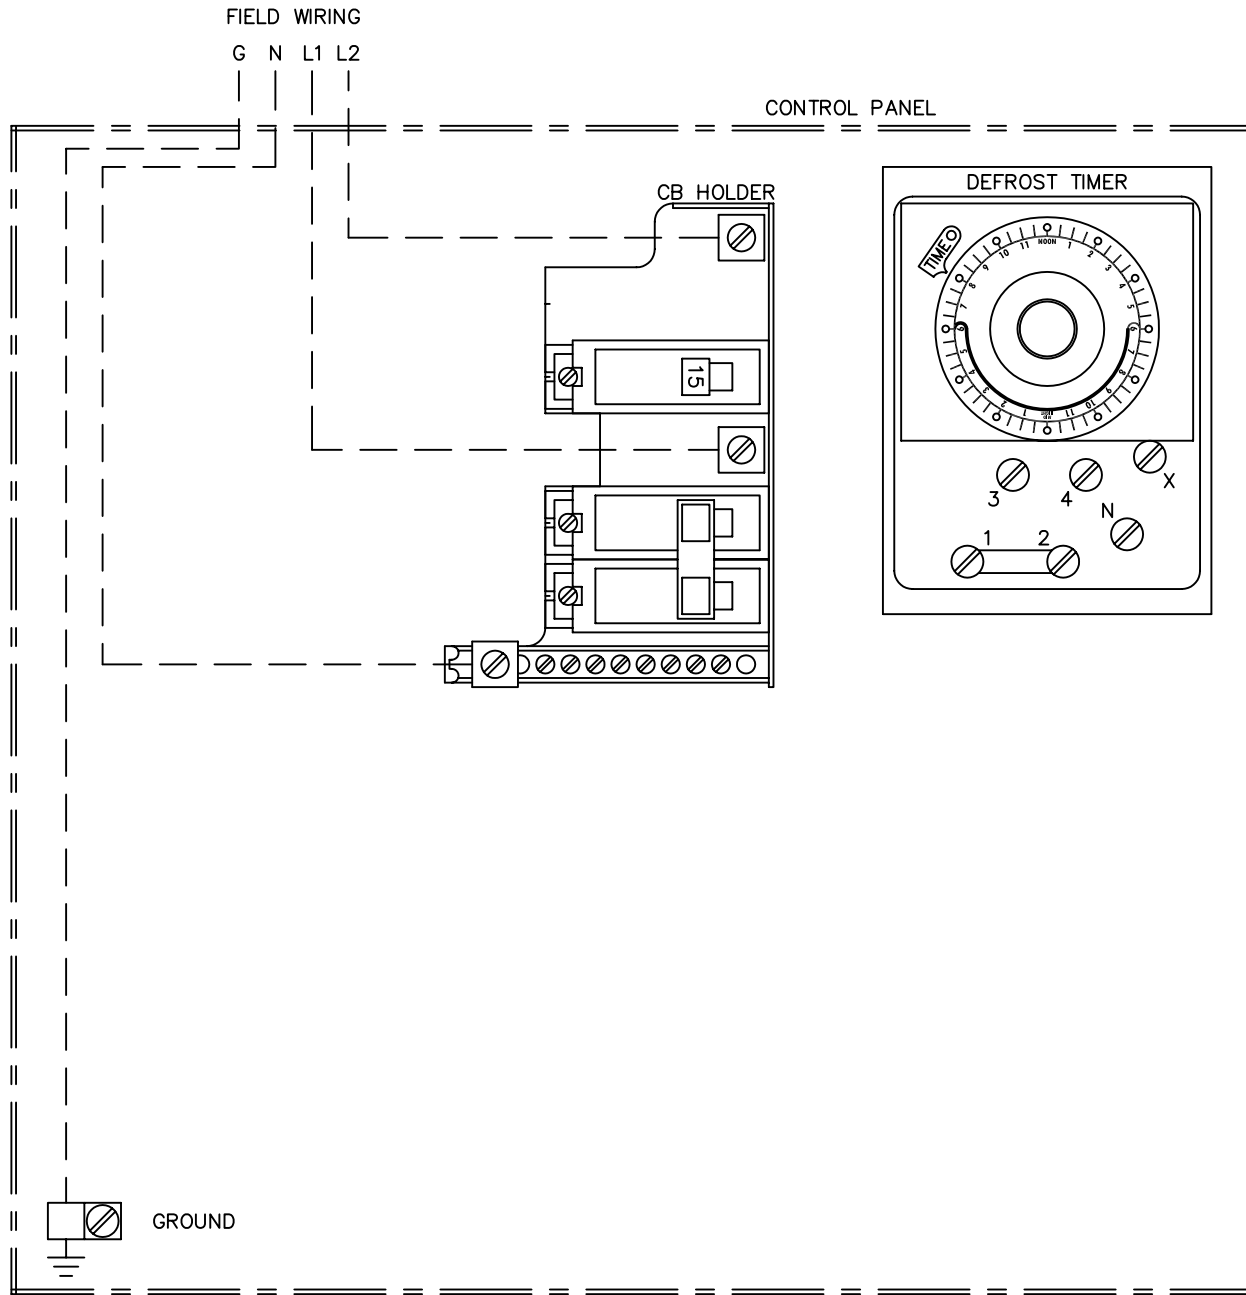

WIRING INSTRUCTIONS

CONTROL PANEL IS LOCATED AT THE CONDENSING UNIT ON TOP OF THE WALK-IN. A HOLE MAY BE DRILLED THRU THE FIBERGLASS CONDENSING UNIT COVER FOR INCOMING POWER. ELECTRICAL HOOK-UP MUST COMPLY WITH THE NATIONAL ELECTRICAL CODE

| | | | |
|---|------------------|------------------|-------------------------|
| WALK-IN TYPE: Cooler or Freezer | | COMPRESSOR TYPE: | |
| VOLTAGE: 208-230 | PHASE: Single | CYCLES: 60 hz | HORSEPOWER: 1/2 to 2 |
| DRAWN BY: MD Leppke | MODEL NO.: | SCALE: None | DATE: 3-13-03 |
| DRAWING NAME: Single Phase Connections | | | |